

Customer Site Requirements

Last verified by Giggs HUANG on 02-28-2025


C I4I

Robby-One requires a WiFi connection.

6002 SP/ 13

Robby-One needs to be installed under a type-1 hood with sufficient space reserved beneath it (please refer to local health/fire department's requirement).

The dimensions of the Robby-One are 31.1 x 39.9 x 68.5 inches. It is recommended to keep at least 2 inches of clearance on the left side of the machine and at least 1 inch on the right side.

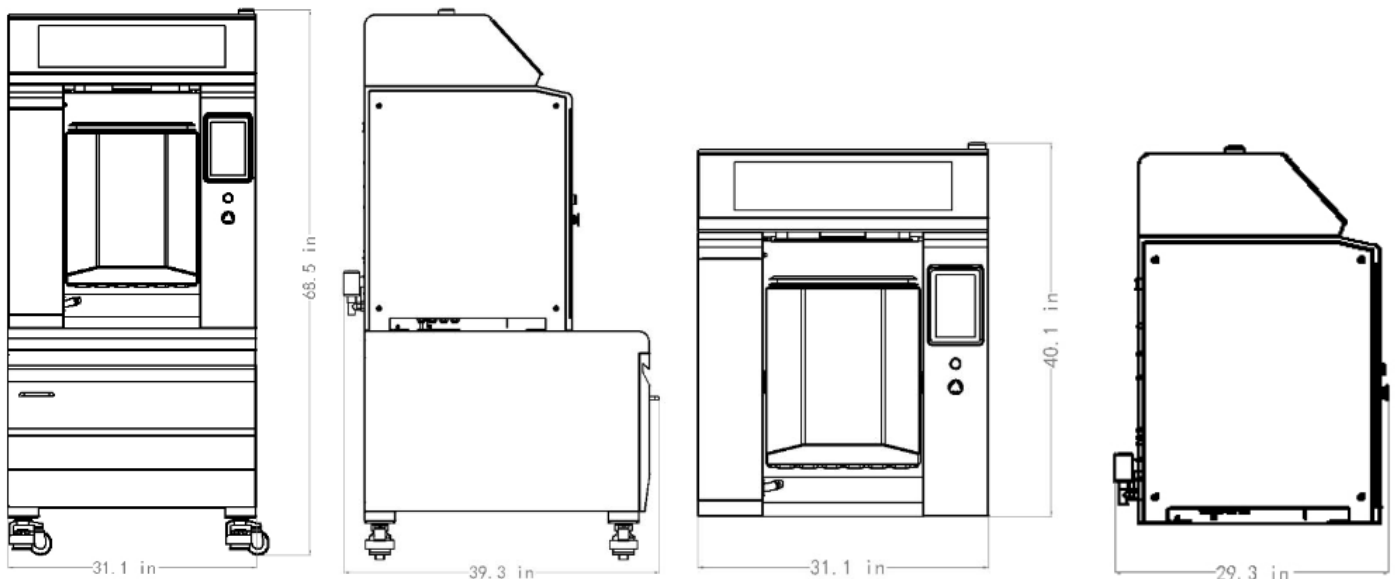

3931 TRI1 ITD

A 220V three-phase power supply with a 50A breaker and #6 gauge wire (three hot wires and one ground wire, no neutral) is required. A NEMA 15-50R 3P 4W receptacle with cover should be located at the back of the Robby-One. The Robby-One comes with a NEMA 15-50 Plug.

Please consult our technician if your amperage is less than 50A. In some circumstance a 40A will work.



C / T3R

The water supply pressure must be $\leq 0.8\text{Mpa}$. A 1/2-In. male Pipe Thread Outlet Stop Valve should be located at the back of the Robby-One. The Robby-One comes with a 60-inch water inlet hose.



2R/ IN/ 53

The drainage should be connected to a grease trap. A 1-inch drain connection should be located at the back of the Robby-One. The Robby-One comes with a 60-inch drain hose.

CI U GRP P I nHRnl HUEMEKI SI UunMR EYRM RYI UQw.



0/ 1 8 BI3C O4 RO00D

